PLAN VIEW

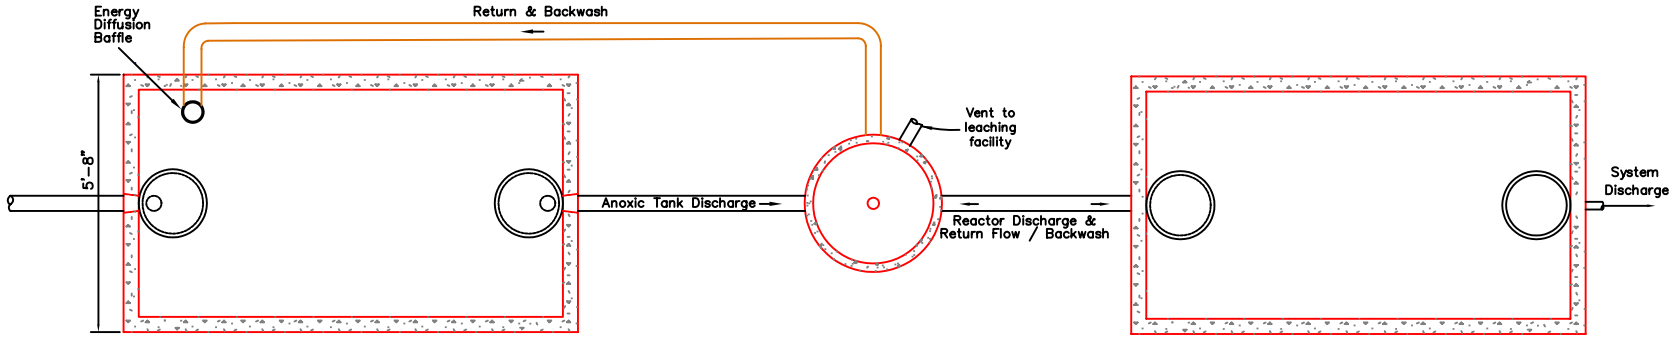

PROFILE VIEW

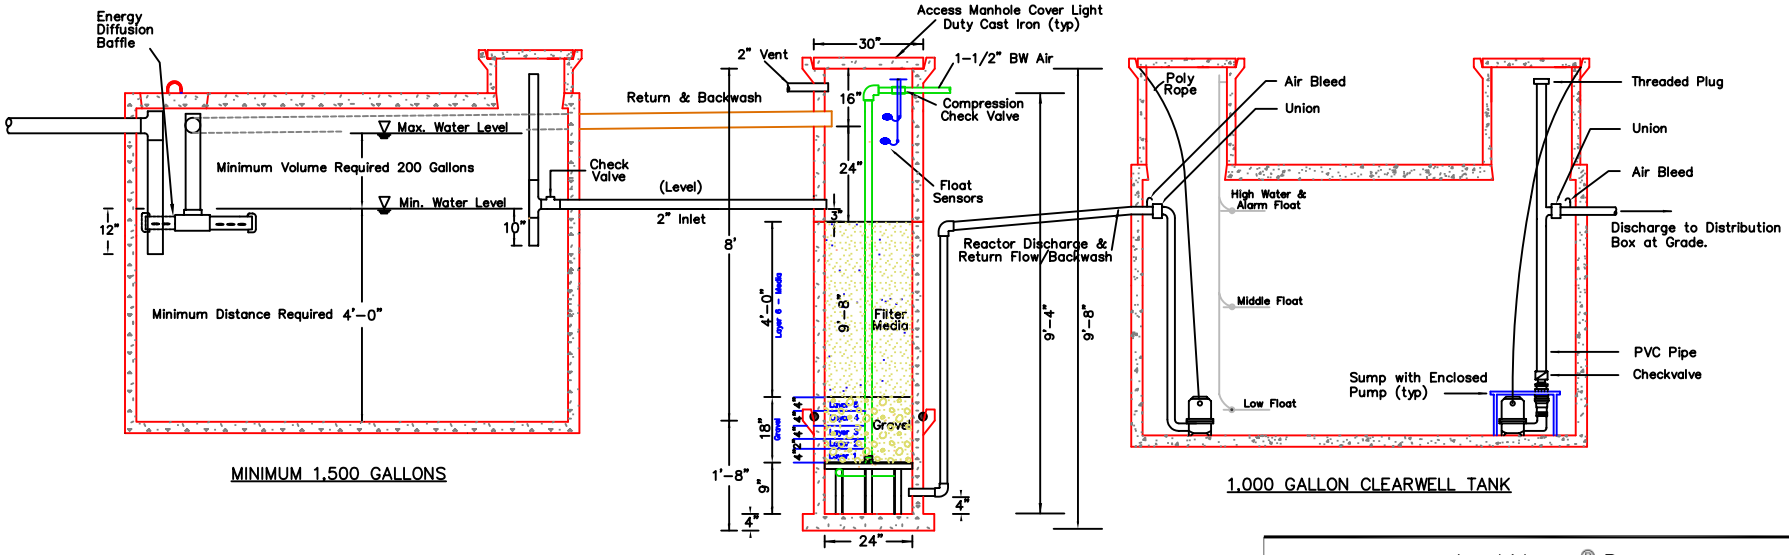

MINIMUM 1,500 GALLONS

AMPHIDROME® REACTOR

1,000 GALLON CLEARWELL TANK

Amphidrome® Process
Single Family Unit

Scale: NTS	Drawn By:	Job No.
Date: 2/12/03	App'd By: PBP	Plan No. 440

F R M AHONY & associates, inc.
Water Supply & Pollution Control Equipment
273 Weymouth Street, Rockland, Massachusetts 02370